



COPYRIGHT © 2009 EMCON  
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY  
 BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR  
 TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC,  
 ELECTROSTATIC, MAGNETIC TAPE, MECHANICAL, PHOTOCOPIING,  
 RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN  
 WRITING FROM EMCON.

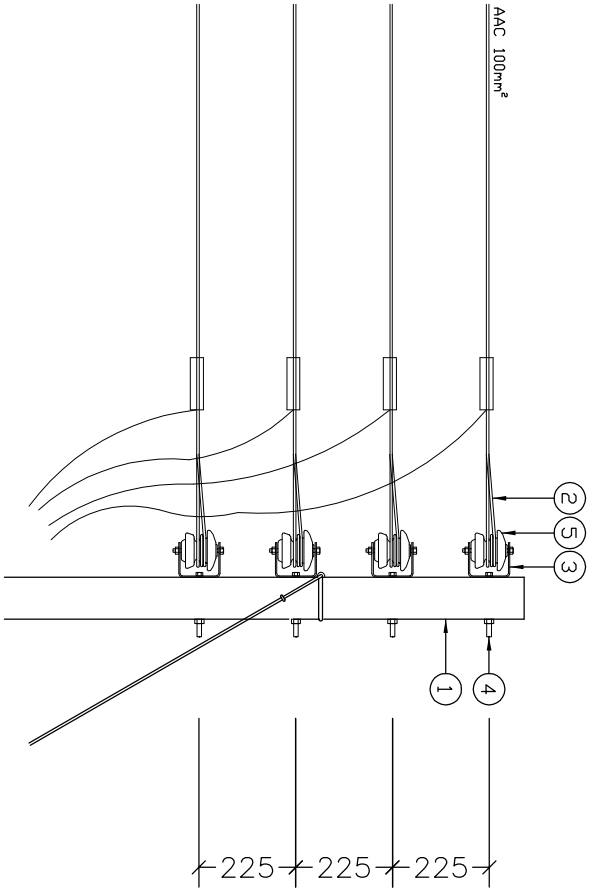

ITEM	DESCRIPTION	QTY	REMARKS
1	WOODEN END POLE	1	9m LONG 180mmØ TOP
2	DEAD END FOR AAC 100mm	4	
3	D-IRON	4	
4	250mm x 16mm LONG GALV BOLT, WASHERS AND NUT	4	
5	SHACKLE INSULATOR 22.25KV	4	

**NOTES:**

**ELECTRICITY CONTROL BOARD**



Box 2923  
 Windhoek  
 NAMIBIA  
 Tel: (061) 374300  
 Fax: (061) 374305

**DRAWING TITLE**

**LOW VOLTAGE BARE OVERHEAD CONDUCTOR  
 DISTRIBUTION, END POLE STRUCTURE  
 –VILLAGE INTERNAL NETWORK–**

<b>DESIGNED:</b> A.K	<b>DRAWN:</b> J.W.S	<b>REV:</b> 01-2001
<b>DRAWING No:</b> STD-LVBOH-06		<b>SCALE:</b> N.T.S



ERROR: syntaxerror  
OFFENDING COMMAND: --nostringval--

STACK:

/Title  
( )  
/Subject  
(D:20100127094658+02'00')  
/ModDate  
( )  
/Keywords  
(PDFCreator Version 0.9.5)  
/Creator  
(D:20100127094658+02'00')  
/CreationDate  
(johnny)  
/Author  
-mark-