



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY
 BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR
 TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC,
 ELECTROSTATIC, MAGNETIC TAPE, MECHANICAL, PHOTOCOPIING,
 REPRODUCING OR OTHERWISE, WITHOUT THE PERMISSION IN
 WRITING FROM EMCON.

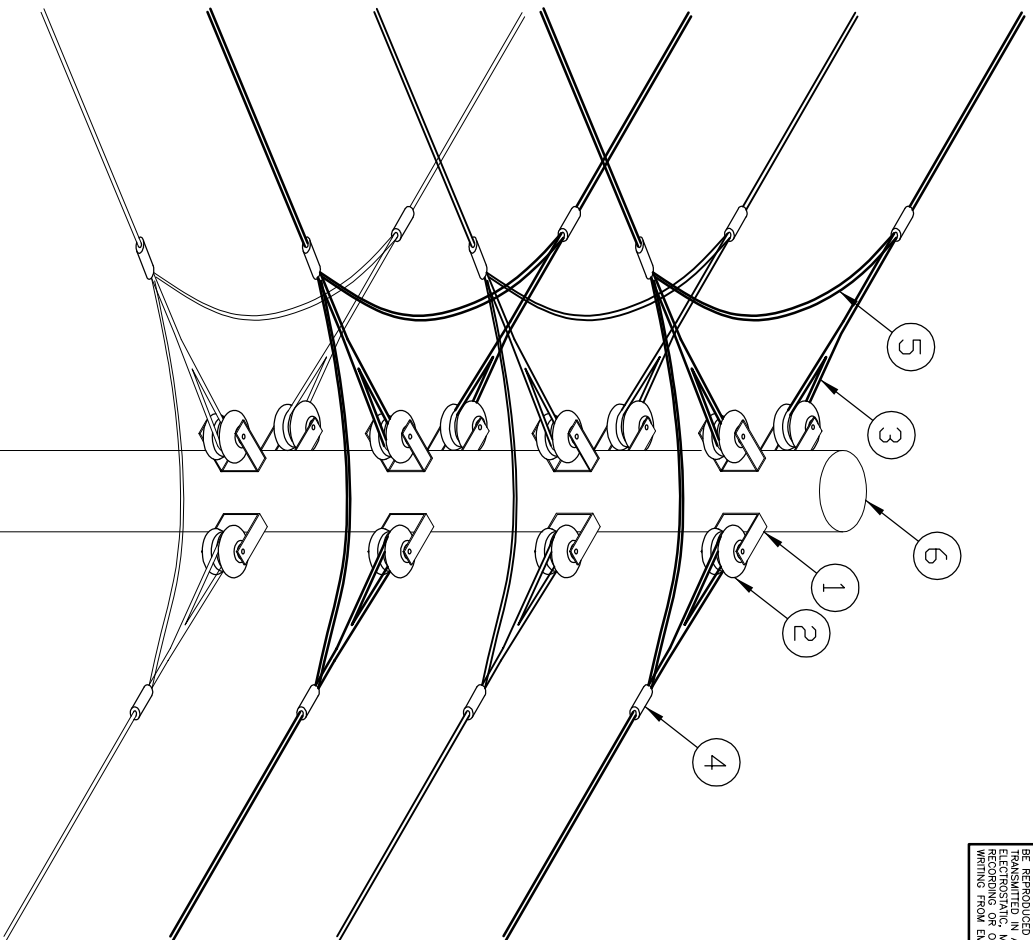

ITEM	DESCRIPTION	QTY	REMARKS
1	D-IRON	4	
2	SHACKLE INSULATOR	4	
3	DEAD END PG CLAMP	4	
4	JUMPER	4	
5	WOODEN POLE	9m	9m LONG 180mmϕ TOP
6			

NOTES:

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE
 LOW VOLTAGE BARE OVERHEAD CONDUCTOR
 DISTRIBUTION, T-OFF POLE STRUCTURE

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-LVBOH-08		
SCALE: N.T.S		

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127095123+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127095123+02'00')
/CreationDate
(johnny)
/Author
-mark-