



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY
 BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR
 TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC,
 ELECTROSTATIC, MAGNETIC TAPE, MECHANICAL, PHOTOCOPYING,
 RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN
 WRITING FROM EMCON.

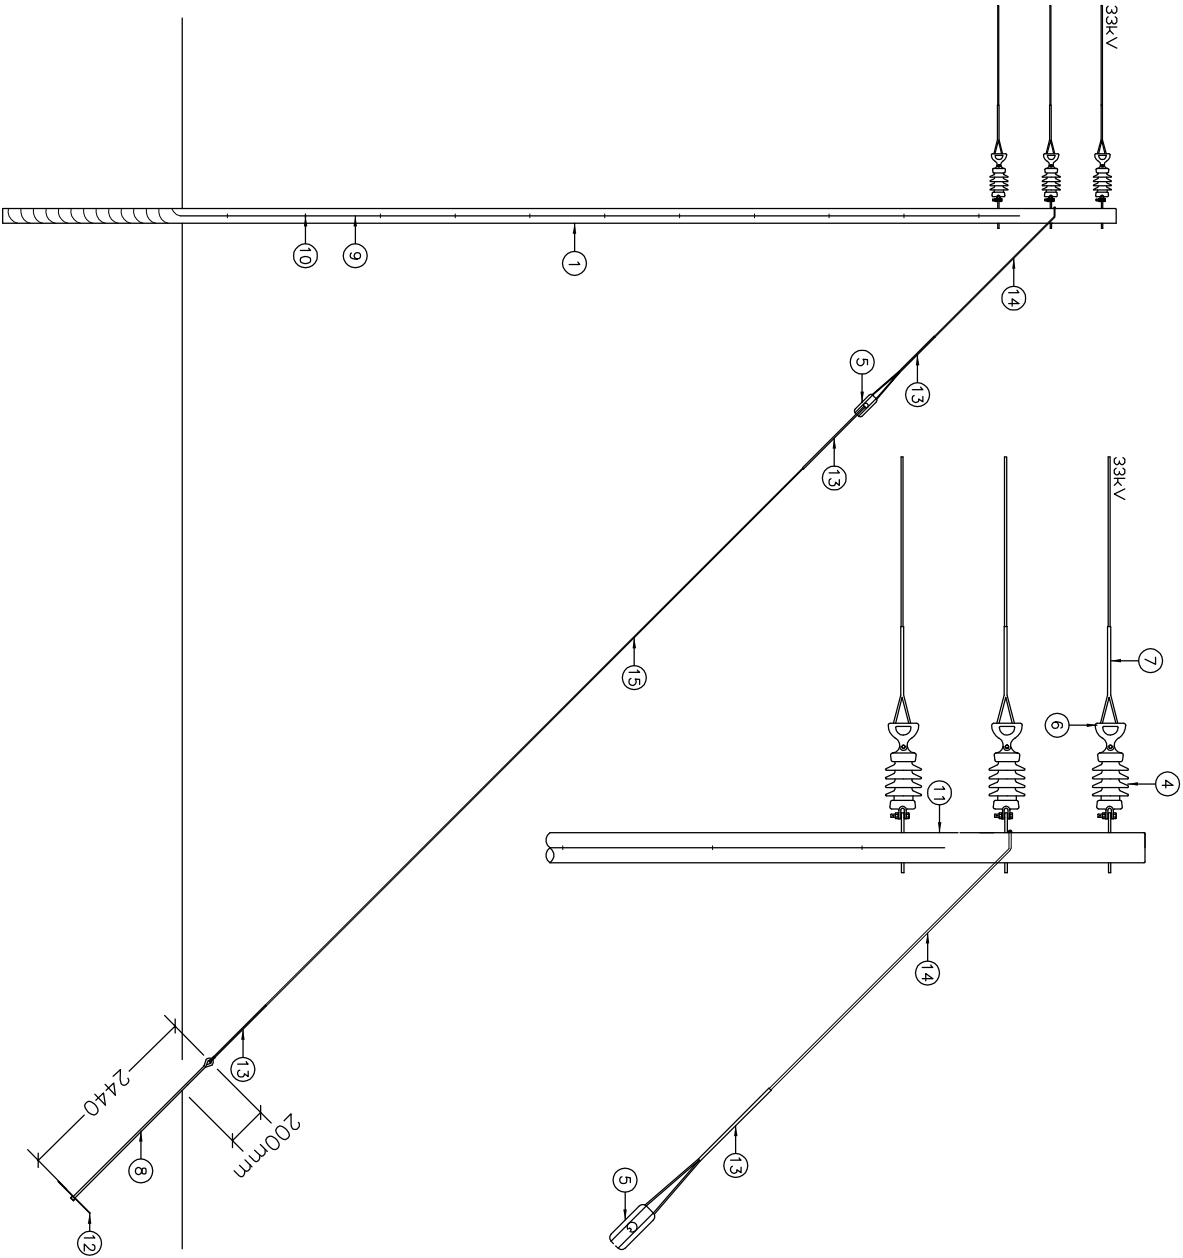

ITEM	DESCRIPTION	QTY	REMARKS
1	WOODEN POLE	1	11m LONG TOP 220mmØ 2m FROM BUTT = 280mmØ
2			
3	LONGROD INSULATOR	3	EP 1044, 1200mm CREEPAGE
4	STAY INSULATOR	1	
5	THIMBLE CLEVIS	3	
6	DEAD END	3	
7	STAY ROD	1	B520 C/W THIMBLE, M20x2440
8	POLE EARTH CONDUCTOR	18	3/4.00mm HOT DIP GALVANISED
9	STAPLES	30	3x32mm HOT DIP GALVANISED
10	BAND-IT STRAPPING	1	20x0.7mm STAINLESS STEEL
11	BASE PLATE	1	450x450x6mm GALVANISED
12	GUY GRIP	3	
13	POLE TOP MAKE OFF	1	
14	STAY WIRE GALVANISED	1	7/4.00 STAYWIRE GALVANISED
15		15	

NOTES:

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE

**MEDIUM VOLTAGE BARE OVERHEAD
 DISTRIBUTION END POLE STRUCTURE
 STAGGERED DELTA LINE CONFIGURATION**

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-MV/SD-33KV-04		SCALE: N.T.S

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127115347+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127115347+02'00')
/CreationDate
(johnny)
/Author
-mark-