



COPYRIGHT © 2009 EMCOR
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, INCLUDING PHOTOCOPIING, ELECTROSTATIC, MAGNETIC TAPE, MECHANICAL, PHOTOGRAPHIC, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCOR.

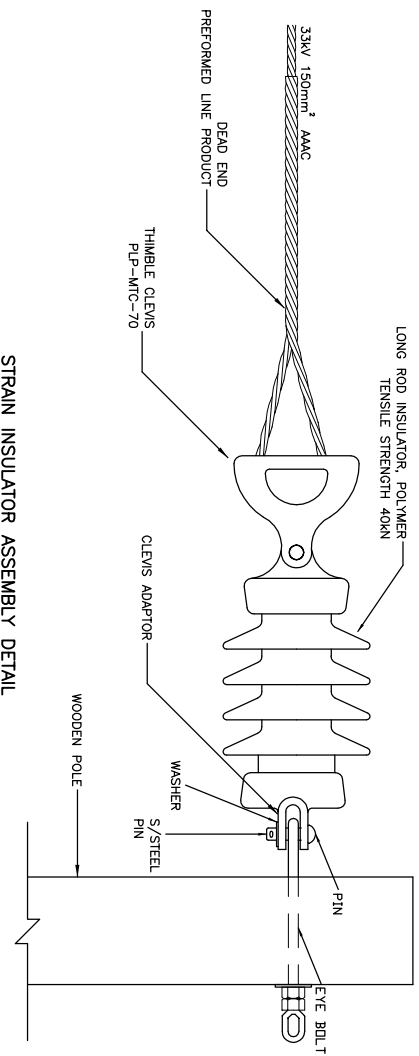

STRAIN INSULATOR ASSEMBLY DETAIL

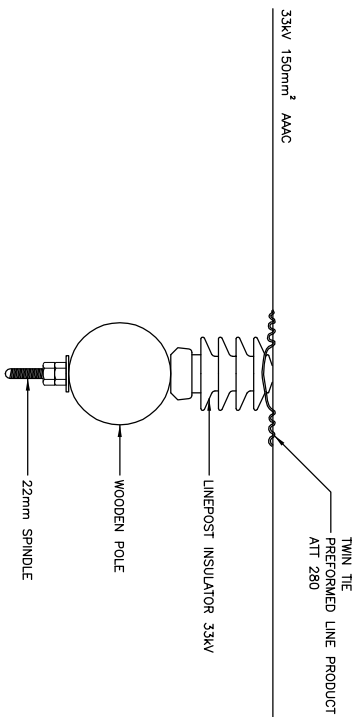


INTERMEDIATE INSULATOR ASSEMBLY DETAIL

ITEM	DESCRIPTION	QTY	REMARKS

NOTES:

ELECTRICITY CONTROL BOARD



Box 2923 Windhoek NAMIBIA
 Tel: (061) 374300 Fax: (061) 374305

DRAWING TITLE

MEDIUM VOLTAGE BARE OVERHEAD DISTRIBUTION MV INSULATOR ASSEMBLY DETAILS
-VILLAGE INTERNAL NETWORK-

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-MV/SD-33KV-14		SCALE: N.T.S

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127115043+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127115043+02'00')
/CreationDate
(johnny)
/Author
-mark-