


COPYRIGHT © 2009 EMCON  
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED, STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

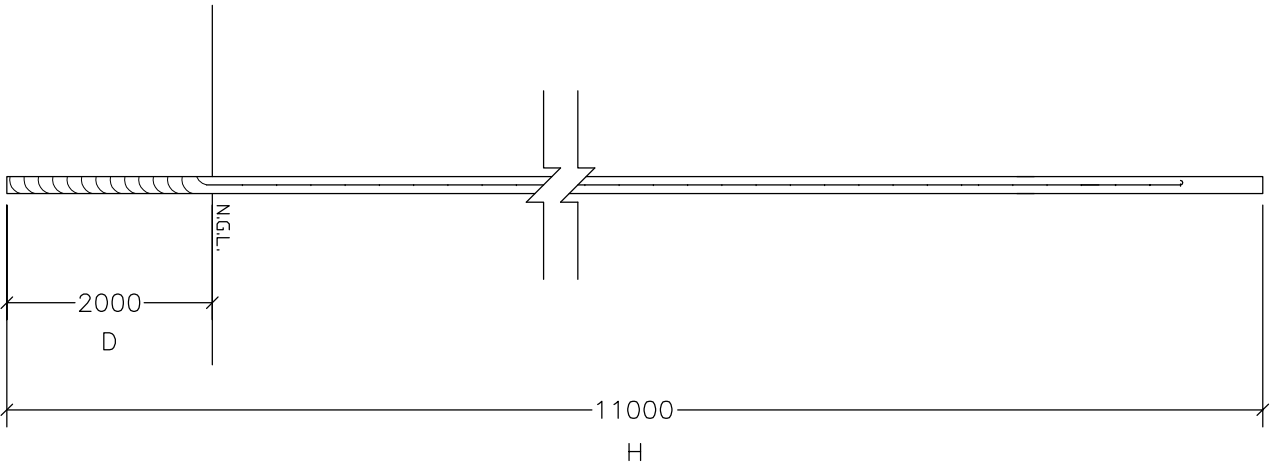


POLE LENGTH H	PLANTING DEPTH ( D )	
	SOIL	SOLID ROCK
9m	1.7m	1.1m
10.5m	1.8m	1.2m
11m	1.8m	1.2m
12m	1.8m	1.2m
14m	2.0m	1.4m

ITEM	DESCRIPTION	QTY	REMARKS

**NOTES:**

- POLE SIZES TO BE USED AS FOLLOWS:  
 A) 9m – LV RETICULATION LINES.  
 B) 11m – FOR MV LINES AND COMBINED MV & LV LINES.
- POLES TO BE PLANTED AT MINIMUM DEPTHS AS SHOWN IN THE TABLE.
- POLES SHALL BE PLANTED VERTICALLY PLUMB AND IN LINE AND SUFFICIENTLY STAYED TO MAINTAIN THAT POSITION.



**Box 2923**  
 Windhoek  
 NAMIBIA

**Tel: (061) 374300**  
**Fax: (061) 374305**

**DRAWING TITLE**

**MEDIUM VOLTAGE BARE OVERHEAD  
 DISTRIBUTION POLE PLANTING DETAIL**

<b>DESIGNED:</b> A.K	<b>DRAWN:</b> J.W.S	<b>REV:</b> 01-2001
<b>DRAWING No:STD-MV/SD-33KV-15</b>		<b>SCALE:</b> N.T.S



ERROR: syntaxerror  
OFFENDING COMMAND: --nostringval--

STACK:

/Title  
( )  
/Subject  
(D:20100127115028+02'00')  
/ModDate  
( )  
/Keywords  
(PDFCreator Version 0.9.5)  
/Creator  
(D:20100127115028+02'00')  
/CreationDate  
(johnny)  
/Author  
-mark-