



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED, STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

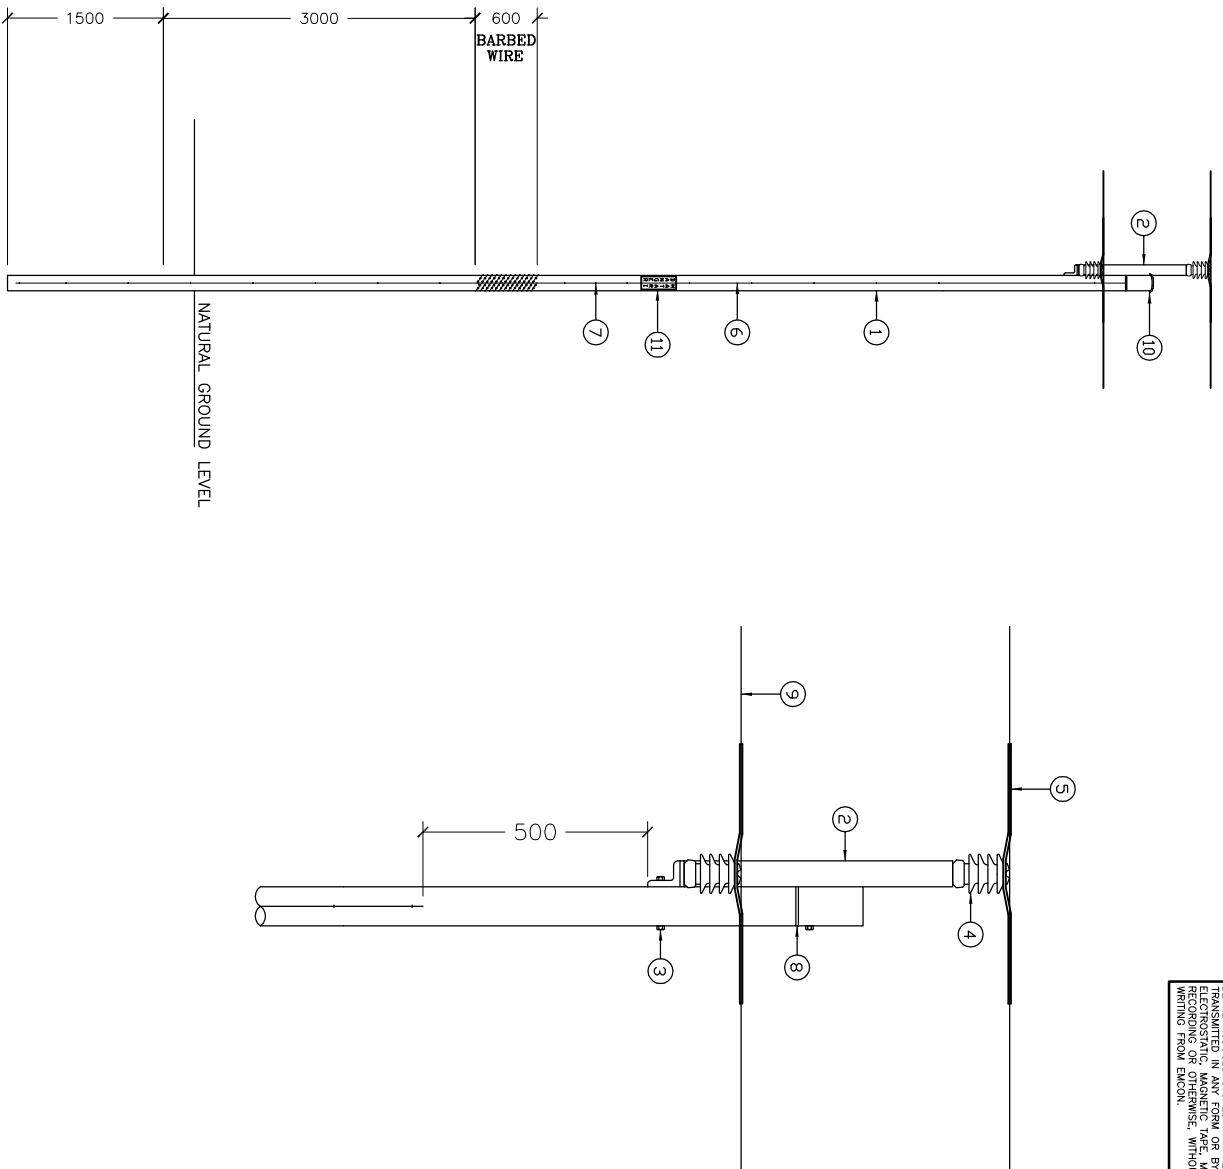

ITEM	DESCRIPTION	QTY	REMARKS
1	WOODEN POLE	1	11m LONG TOP 160mm ²
2	INTERMEDIATE A-FRAME	1	SEE DWG NO. STD-MVAF-12
3	BOLTS	2	COLLUMEN V0374 COMPLETE
4	PH INSULATOR	3	COLLUMEN ER414 COMPLETE
5	WAP-LOCK	3	FP-AMT 209-280
6	POLE EARTH CONDUCTOR	11m	17,400mm STRIP WIRE
7	STRAP-LETS	40	35x2mm HOT DIP GALVANISED
8	BARE ALUMINIUM CONDUCTOR	1	20x6,7mm STAINLESS STEEL
9	POLE CAP	1	ACSX
10	POLE CAP		
11	DANGER PLATE		

NOTES:
 1. THE A-FRAME AND BOLTS C/W NUTS AND WASHERS SHALL BE HOT DIPPED GALVANISED TO SABS 763.

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 224725
 Fax: (061) 233207

DRAWING TITLE
 MEDIUM VOLTAGE BARE OVERHEAD DISTRIBUTION
 INTERMEDIATE POLE STRUCTURE : A-FRAME

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-MVAF-11KV-05	SCALE: N.T.S	

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127124138+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127124138+02'00')
/CreationDate
(johnny)
/Author
-mark-