



COPYRIGHT © 2009 EMCON
 All rights reserved. No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, electrostatic, magnetic tape, mechanical, photocopying, recording, or otherwise, without the permission in writing from EMCON.

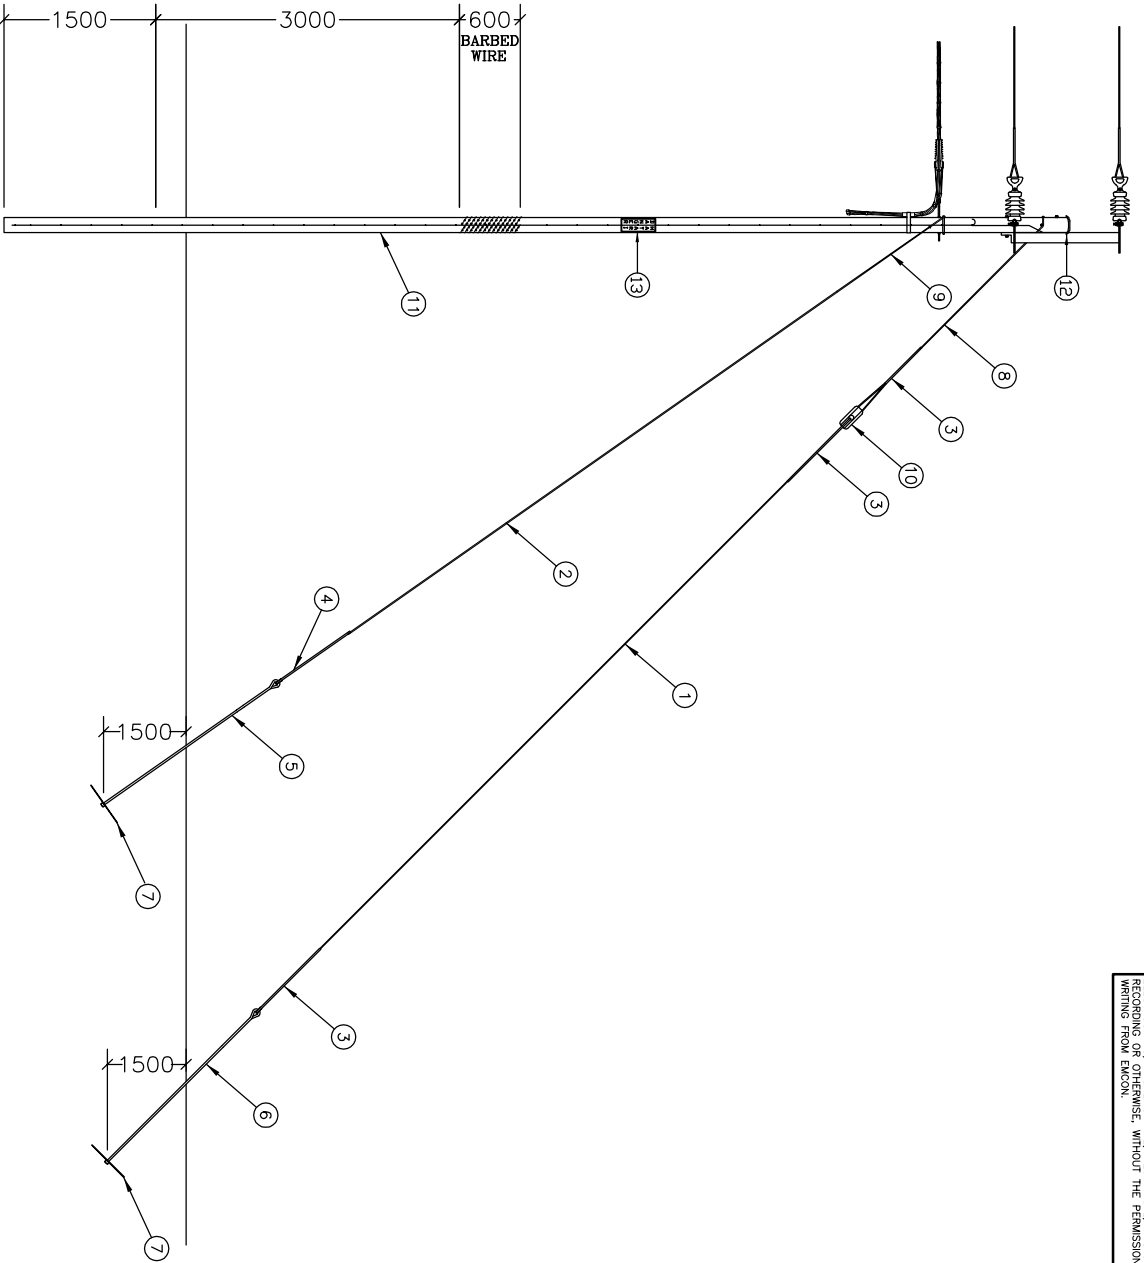

ITEM	DESCRIPTION	QTY	REMARKS
1	STAY WIRE MV	15m	7/20G GALVANISED
2	STAY WIRE LV	15m	7/4.00 GALVANISED
3	GRIP MV	1	FLP - GSDE 472
4	GRIP LV	3	FLP - GSDE 345
5	STAY ROD LV C/W THIMBLE	1	COLLINK B57 12X1500mm
6	STAY ROD MV C/W THIMBLE	1	COLLINK B57 20X2000mm
7	BASE PLATE	1	450x450x6mm
8	POLE TOP MAKE OFF MV	1	DMG - 432
9	DOUBLE FRAME 50T GRIP	2	COLLINK 21-0522
10	STAY INSULATOR	1	11m LONG WITH 150mm ϕ TOP
11	WOODEN POLE	1	
12	POLE CAP	1	
13	DANGER PLATE	1	

- NOTES:**
1. LV NEUTRAL IS NOT CONNECTED TO POLE EARTH
 2. THE A-FRAME MUST BE EARTHED.

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE
 MEDIUM VOLTAGE BARE OVERHEAD DISTRIBUTION
 COMBINED MV & LV END POLE STRUCTURE

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-MV/AF-11(V)-08	SCALE: N.T.S	

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127124023+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127124023+02'00')
/CreationDate
(johnny)
/Author
-mark-