



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

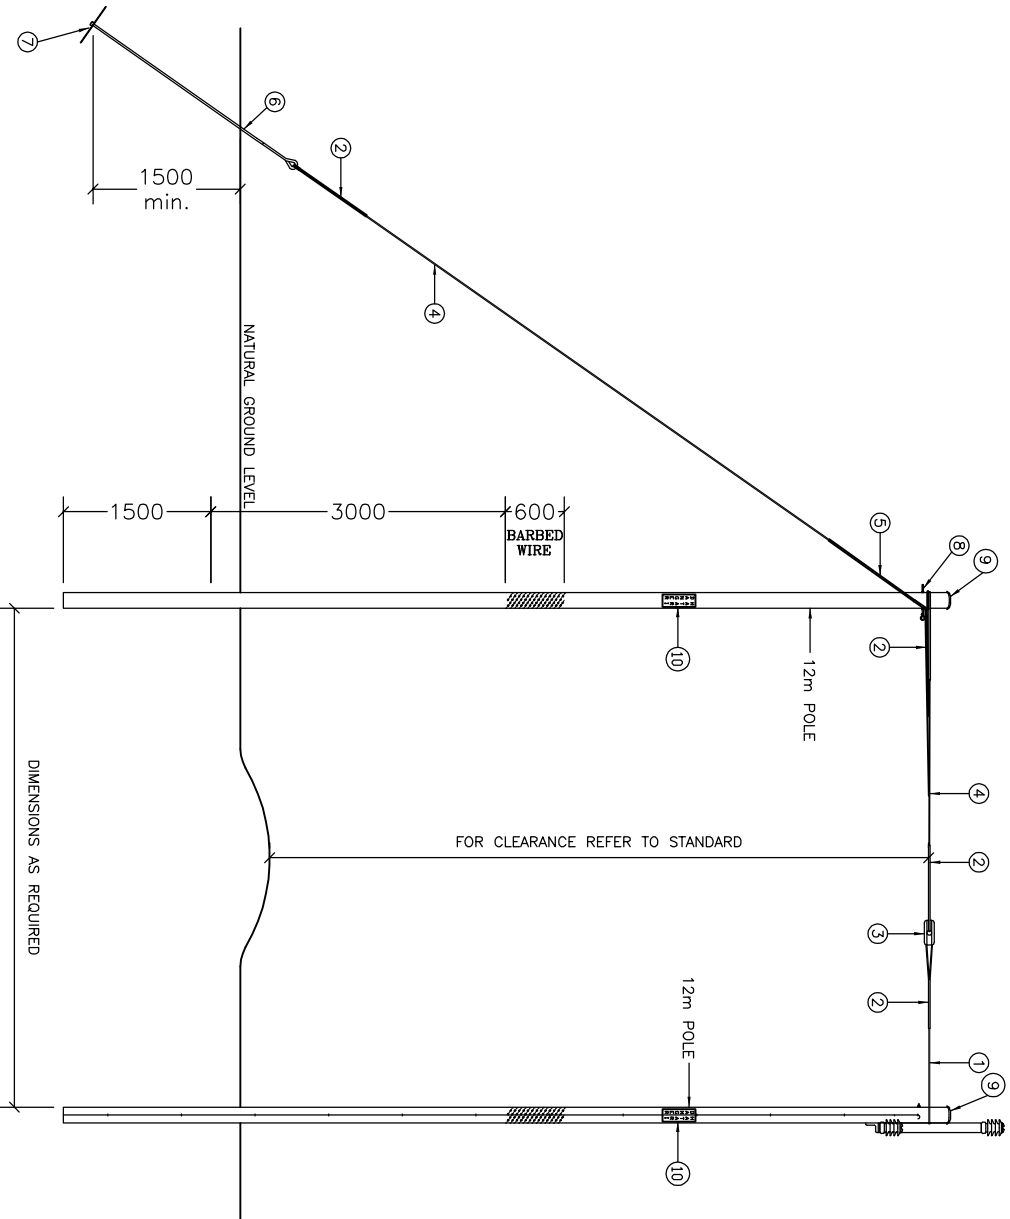

ITEM	DESCRIPTION	QTY	REMARKS
1	POLE TOP MAKE OFF	1	PT 472-6
2	GUY GRIP	4	GSPF 472
3	INSULATOR	1	CULLINAN 0522
4	STAY WIRE	40m	5/4 STAY WIRE
5	DOUBLE WRAP GUY GRIP	1	DWGG FOR 7/4.00
6	STAY ROD WITH THIMBLE	1	2400mm LONG x 16mm ^ø
7	BASE PLAT	1	350x350x6mm GMS
8	EYE BOLT WITH THIMBLE	1	M20x250
9	POLE CAP		
10	DANGER PLATE		

- NOTES:**
1. USED ONLY WHERE MV POLE STAY ASSEMBLY WILL NOT FIT OR AS INSTRUCTED.
 2. FIT HORIZONTAL INSULATOR CLOSE AS POSSIBLE TO LINE POLE

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

**MEDIUM VOLTAGE BARE OVERHEAD DISTRIBUTION
 MV FLY STAY ASSEMBLY**

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-MVA-F-33Kv-17		SCALE: N.T.S

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127125332+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127125332+02'00')
/CreationDate
(johnny)
/Author
-mark-