



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

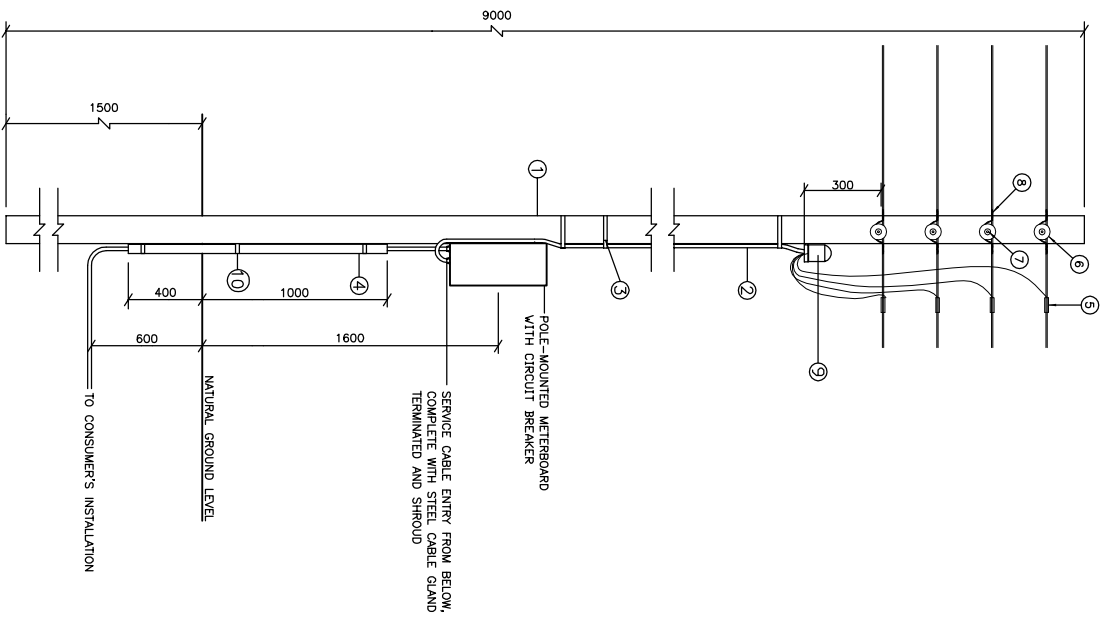

ITEM	DESCRIPTION	QTY	REMARKS
1	WOODEN POLE	1	9m LONG WITH TOP 140mm ϕ MIN
2	SUPPLY CABLE	-	SIZE AND LENGTH AS REQUIRED
3	BAND-IT STRAPPING	8	20x0,7mm STAINLESS STEEL
4	KICK PIPE	1,4m	50mm ϕ HDPE
5	FG CLAMP	4	
6	WHITE GLAZED PORCELAIN REEL	4	
7	INSULATOR	4	
8	250mm x 16mm LONG GALV BOLT, WASHERS AND NUT	4	
9	SIDE TIE	4	
10	CABLE HOOD FOR 50mm ϕ GALV. SADDLES	4	POLE BOX FOR 50mm ϕ KICK PIPE

NOTES:

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE
 LOW VOLTAGE BARE OVERHEAD CONDUCTOR
 DISTRIBUTION, THREE PHASE SERVICE
 CONNECTION WITH METERBOARD

DESIGNED: A.K **DRAWN:** J.W.S **REV:** 01-2001
DRAWING No: STD-LVBOH-14 **SCALE:** N.T.S

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127093906+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127093906+02'00')
/CreationDate
(johnny)
/Author
-mark-