


COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY
 BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR
 TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC,
 ELECTROSTATIC, MAGNETIC TAPE, MECHANICAL, PHOTOCOPIING,
 RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN
 WRITING FROM EMCON.

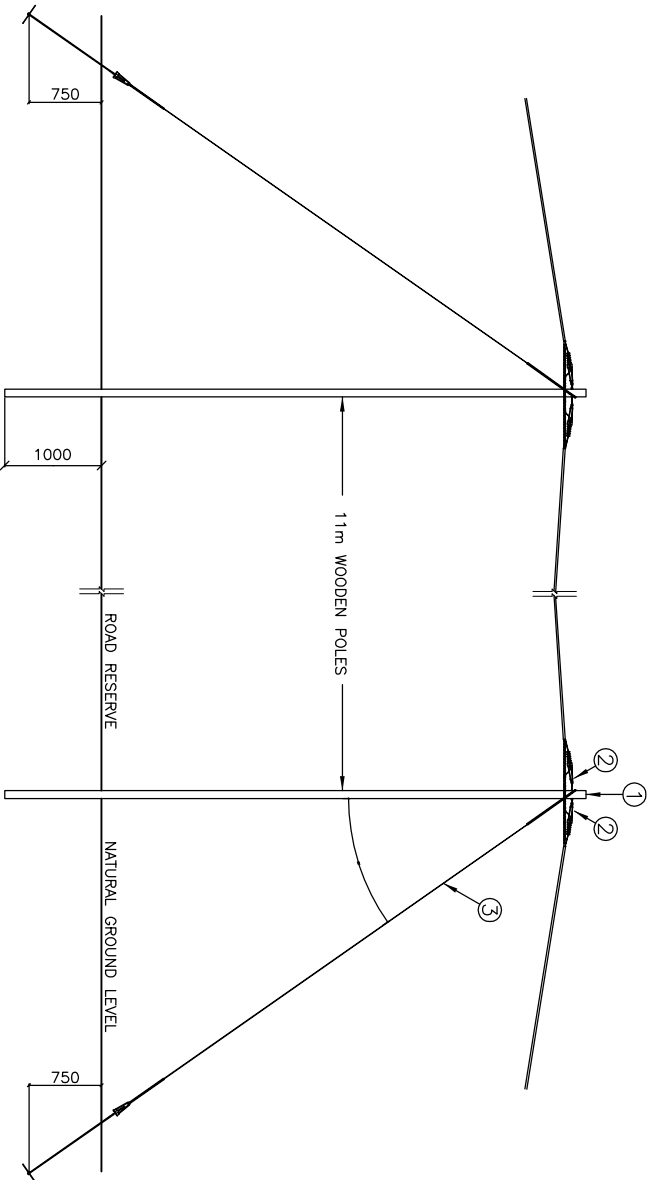


ITEM	DESCRIPTION	QTY	REMARKS
1	WOODEN POLE	2	11m LONG WITH TOP 160mm ϕ
2	ABC CABLE STRAIN ASSEMBLY	4	SEE DWG STD-LVABC-09
3	LV STAY ASSEMBLY	2	SEE DWG STD-LVABC-15

NOTES:

- THIS ARRANGEMENT TO BE USED FOR ALL ROAD CROSSINGS OR AS INSTRUCTED BY THE ENGINEER.
- BOTH POLES ARE TO BE PLACED OUTSIDE THE ROAD RESERVE. CONTRACTOR TO DETERMINE THE EXACT ROAD WIDTH FOR EACH TYPE OF ROAD.

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

**LOW VOLTAGE AERIAL BUNDLED
 CONDUCTOR DISTRIBUTION: ROAD
 CROSSING DETAIL**

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-LVABC-17	SCALE: N.T.S	

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127105518+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127105518+02'00')
/CreationDate
(johnny)
/Author
-mark-