



COPYRIGHT © 2000 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

POLE LENGTH H	PLANTING DEPTH D
5m	1,3m
8m	1,4m
9m	1,5m
10m	1,6m
11m	1,8m
12m	2,0m

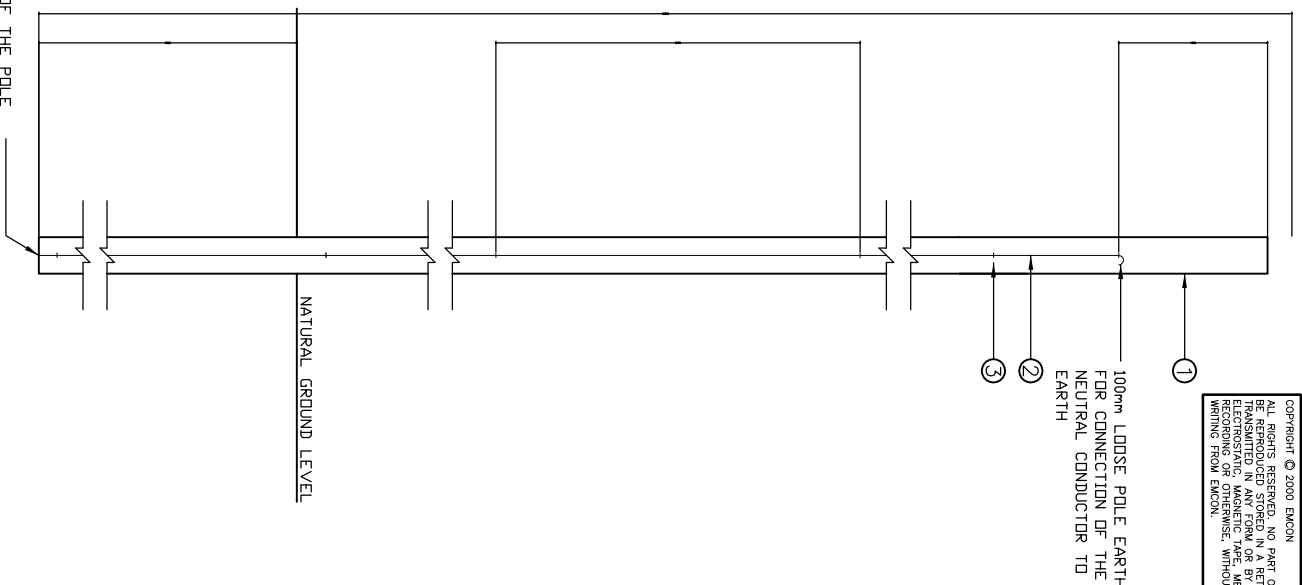

ITEM	DESCRIPTION	QTY	REMARKS
1	WOODEN POLE	1	9m LONG WITH TOP 160mm ϕ
2	POLE EARTH CONDUCTOR AS REQUIRED	9m	47mm ϕ GALVANISED STEEL WIRE
3	STAPLES	30	3x32mm HOT DIPPED GALVANISED

- NOTES:
- POLE SIZES TO BE USED AS FOLLOWS:
 - 9m - LV RETICULATION LINES.
 - 11m - FOR HV LINES AND COMBINED MV & LV LINES.
 - 12m - FOR ALL ROAD CROSSINGS.
 - POLES TO BE PLANTED AT MINIMUM DEPTHS AS SHOWN IN THE TABLE.
 - POLES SHALL BE PLANTED VERTICALLY PLUMB AND IN LINE AND SUFFICIENTLY STAYED TO MAINTAIN THAT POSITION.
 - THE POLE EARTH CONDUCTOR SHALL BE STAPLED ON THE EYEBOLT OR PIGTAIL BOLT BETWEEN FISHPLATE AND POLE.



ELECTRICITY CONTROL BOARD
 Box: 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

**LOW VOLTAGE AERIAL BUNDLED
 CONDUCTOR DISTRIBUTION:
 POLE PLANTING DETAIL FOR LV POLES**

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-LVABC-27		SCALE: N.T.S

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127102507+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127102507+02'00')
/CreationDate
(johnny)
/Author
-mark-