


COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, INCLUDING ELECTROSTATIC, MAGNETIC TAPE, MECHANICAL, PHOTOCOPYING, PHOTODUPLICATION, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

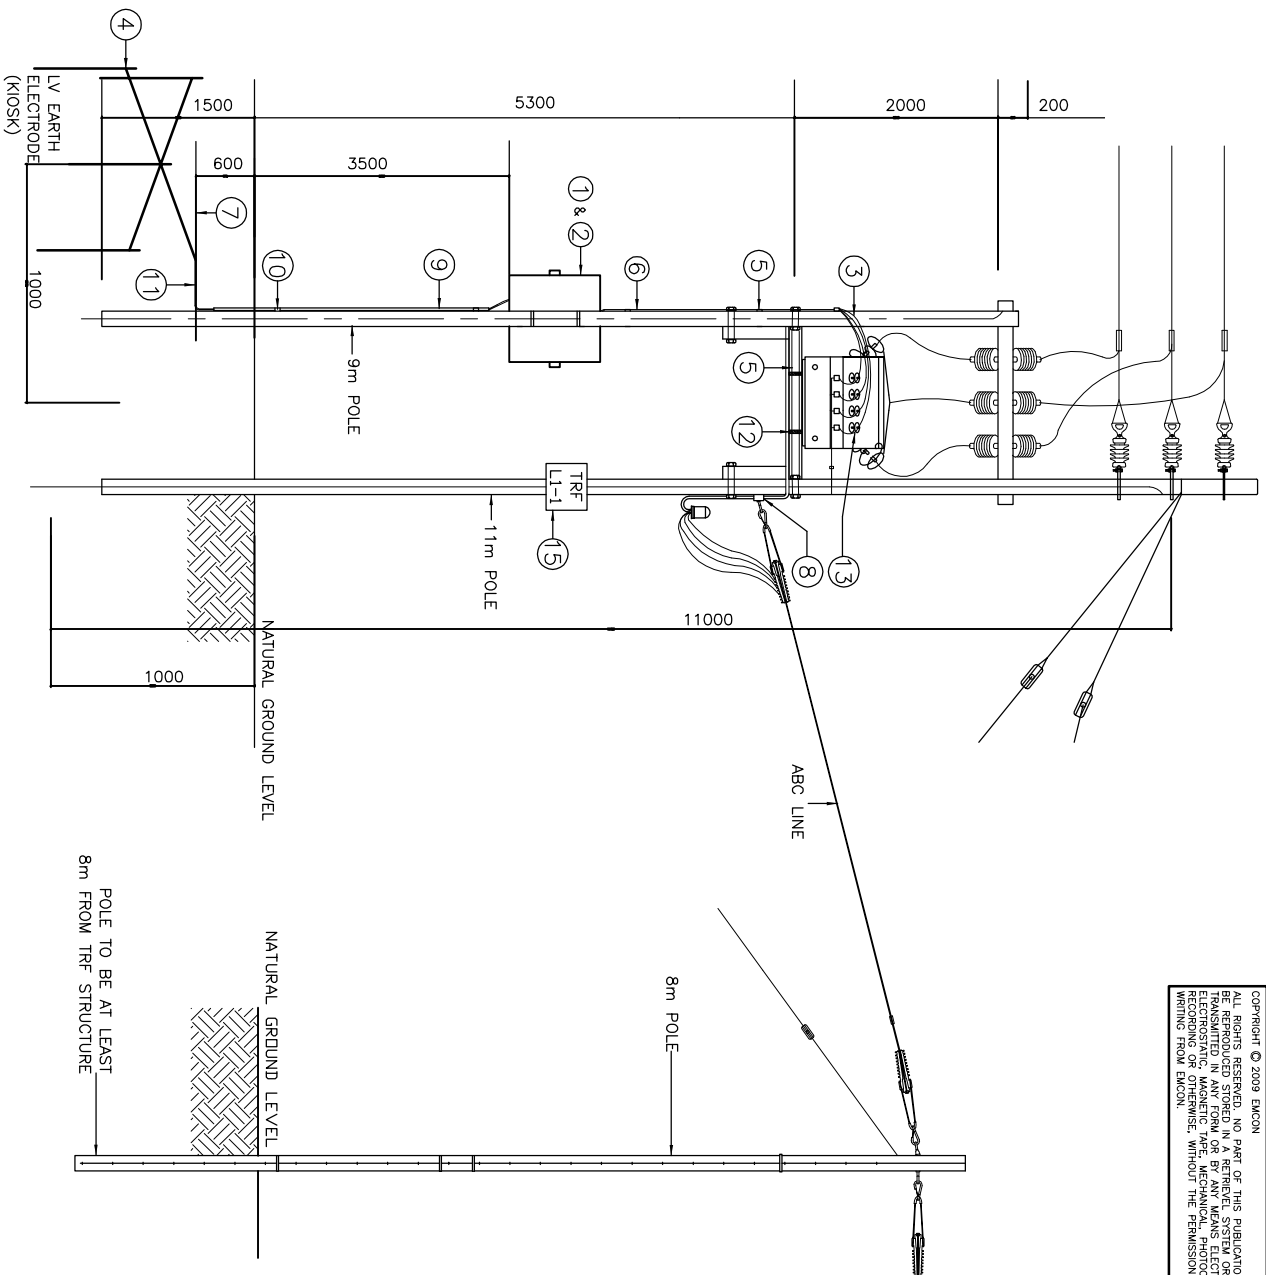


DISTRIBUTION TRANSFORMER

ITEM	DESCRIPTION	QTY	REMARKS
1	POLE MOUNTED DB	1	
2	STREETLIGHT METERBOARD	1	SEE DWG. STD-LVABC-28
3	PVDC	-	SIZE AS SPECIFIED
4	EARTH SPIKE	4	1.2m LONG, 16mm
5	KICK PIPE	1.4m	50mm ϕ HDPE
6	STAPLES	2	
7	EARTH CONDUCTOR	14m	70mm ² BARE CU CONDUCTOR
8	EYE NUT		
9	KICK PIPE		
10	GALVANISED SADDLES		
11	METERBOARD	5	
12	BAND-IT STRAPPING		
13	TERMINATION LUGS	8	
14	TUFLON GLANDS		
15	SIGN BOARD		AS PER SPECIFICATION

- NOTES:**
1. TRANSFORMER EARTH TO BE SEPARATE FROM KIOSK EARTH.
 2. LV EARTHING CONDUCTOR OF KIOSK TO BE INSTALLED IN A TRENCH FOR 1m AND TERMINATED AT A THREE-POINT STAR EARTH

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE
 LOW VOLTAGE AERIAL BUNDLED
 CONDUCTOR DISTRIBUTION:
 ABC TAP-IN FROM LOCAL SUPPLY
 AUTHORITY TRANSFORMER

DESIGNED: A.K **DRAWN:** J.W.S **REV:** 01-2001
DRAWING No: STD-LVABC-35 **SCALE:** N.T.S

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127100403+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127100403+02'00')
/CreationDate
(johnny)
/Author
-mark-