



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

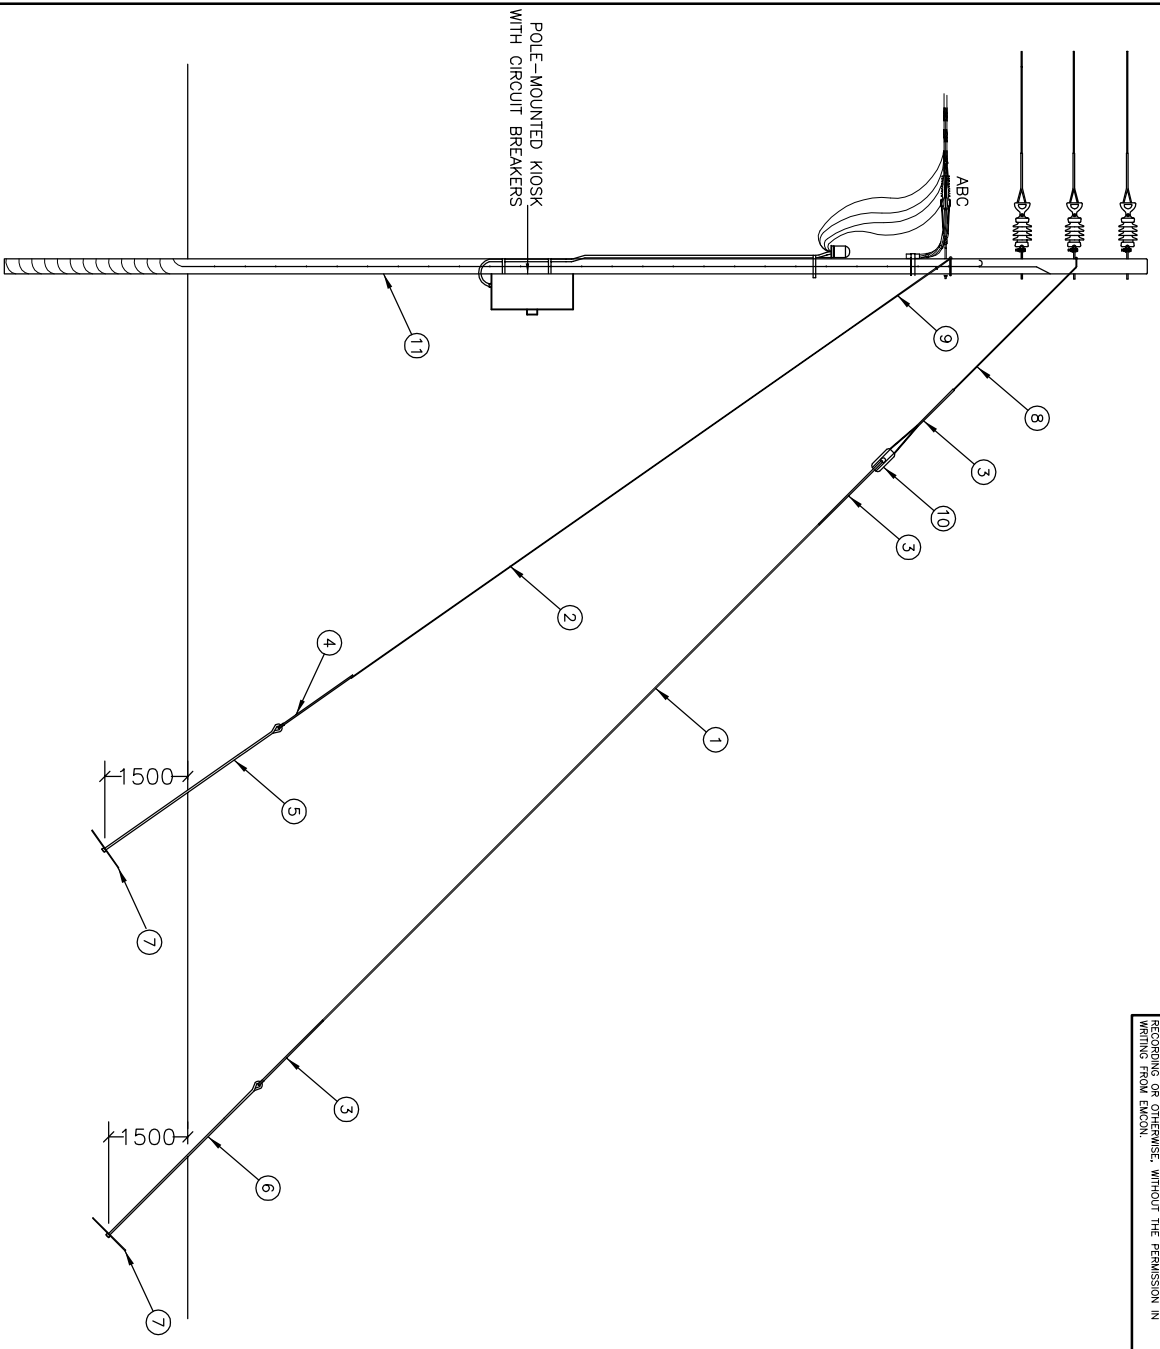

ITEM	DESCRIPTION	QTY	REMARKS
1	STAY WIRE MV	15m	
2	STAY WIRE LV	15m	
3	GU Y GRIP MV	3	3/4.00 GALVANISED RIP - OSDI 472
4	GU Y GRIP LV	3	RIP - OSDI 345
5	STAYROD LV C/W THIMBLE	1	CULLINAN B57 12x1500mm
6	STAYROD MV C/W THIMBLE	1	CULLINAN B57 20x2000mm
7	BASE PLATE	1	450x450x6mm
8	POLE TOP MAKE OFF MV	1	RIP - PT - 472-6
9	DOUBLE WRAP GU Y GRIP	1	DWGS 432
10	STAY INSULATOR	2	
11	WOODEN POLE	1	11m LONG WITH 220mmØ TOP

NOTES:
 1. LV NEUTRAL IS NOT CONNECTED TO POLE EARTH

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE
 MEDIUM VOLTAGE BARE OVERHEAD
 DISTRIBUTION MV & LV END POLE
 STRUCTURE
 -VILLAGE INTERNAL NETWORK-

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-MV/SD-33KV-08		SCALE: N.T.S

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127115154+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127115154+02'00')
/CreationDate
(johnny)
/Author
-mark-