


COPYRIGHT © 2009 EMCOR  
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED, STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE PERMISSION IN WRITING FROM EMCOR.

1. POLE SIZES TO BE USED AS FOLLOWS:
  - A) 5m – SERVICE CONNECTION KICK POLES
  - B) 8m & 9m – LV RETICULATION LINES.
  - C) 11m – FOR MV LINES AND COMBINED MV & LV LINES.
  - D) 12m – FOR ALL ROAD CROSSINGS.
2. POLES TO BE PLANTED AT MINIMUM DEPTHS AS SHOWN IN THE TABLE.
3. POLES SHALL BE PLANTED VERTICALLY PLUMB AND IN LINE AND SUFFICIENTLY STAYED TO MAINTAIN THAT POSITION.
4. THE POLE EARTH CONDUCTOR SHALL BE STAPLED TO THE POLE AT 500mm C/C AND TERMINATED ON THE EYEBOLT OR RIGTAL BOLT BETWEEN FISHPLATE AND POLE.

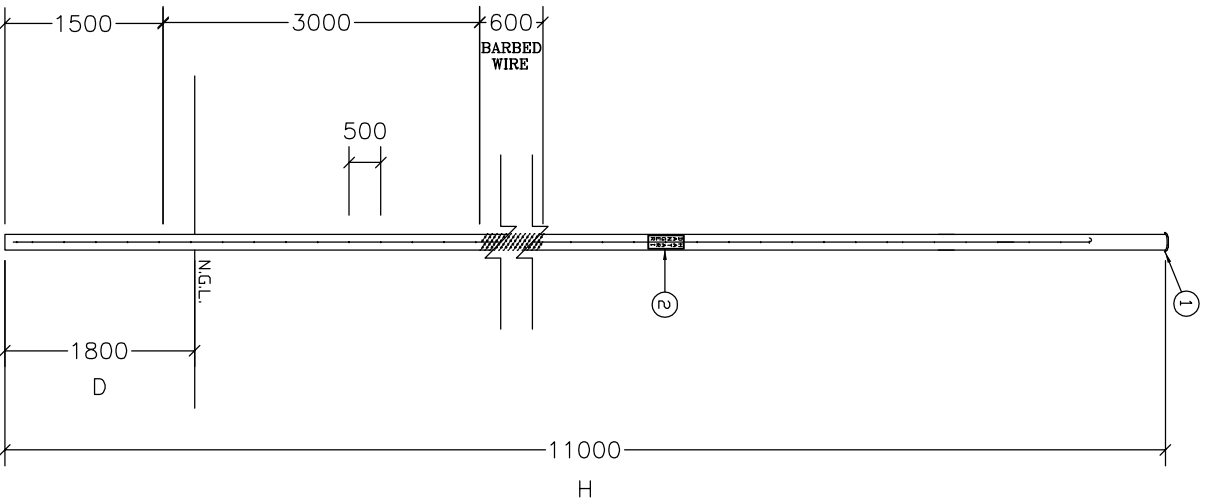


| POLE LENGTH<br>H | PLANTING DEPTH<br>D |
|------------------|---------------------|
| 5m               | 1.3m                |
| 8m               | 1.4m                |
| 9m               | 1.5m                |
| 11m              | 1.8m                |
| 12m              | 2.0m                |

| ITEM | DESCRIPTION | QTY | REMARKS |
|------|-------------|-----|---------|
| 1    | POLE CAP    |     |         |
| 2    | DAISY PLATE |     |         |
|      |             |     |         |
|      |             |     |         |
|      |             |     |         |
|      |             |     |         |
|      |             |     |         |
|      |             |     |         |
|      |             |     |         |
|      |             |     |         |
|      |             |     |         |

**NOTES:**

**ELECTRICITY CONTROL BOARD**



ELECTRICITY CONTROL BOARD

Box 2923  
Windhoek  
NAMIBIA

Tel: (061) 374300  
Fax: (061) 374305

**DRAWING TITLE**

**MEDIUM VOLTAGE BARE OVERHEAD DISTRIBUTION  
POLE PLANTING DETAIL**

|                                      |                     |                     |
|--------------------------------------|---------------------|---------------------|
| <b>DESIGNED:</b> A.K                 | <b>DRAWN:</b> J.W.S | <b>REV:</b> 01-2001 |
| <b>DRAWING No:</b> STD-MVA/F-11KV-15 | <b>SCALE:</b> N.T.S |                     |



ERROR: syntaxerror  
OFFENDING COMMAND: --nostringval--

STACK:

/Title  
( )  
/Subject  
(D:20100127122920+02'00')  
/ModDate  
( )  
/Keywords  
(PDFCreator Version 0.9.5)  
/Creator  
(D:20100127122920+02'00')  
/CreationDate  
(johnny)  
/Author  
-mark-