


COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

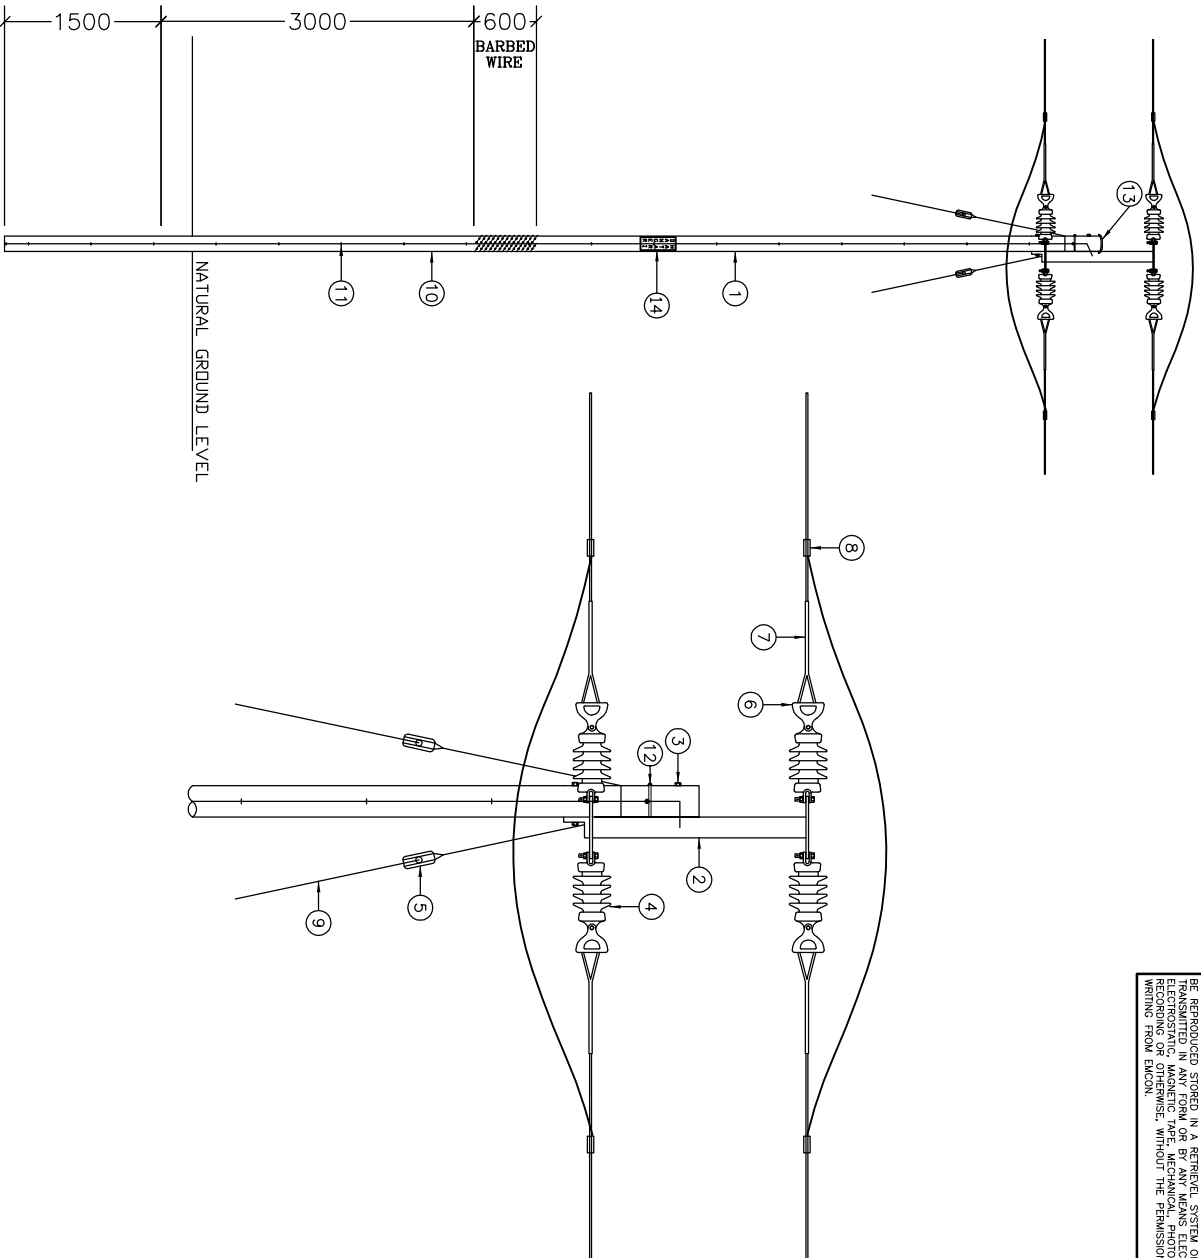


ITEM	DESCRIPTION	QTY	REMARKS
1	WOODEN POLE	1	11m LONG TOP 160mm ϕ
2	STRAIN A-FRAME	1	SEE DWG NO. STD-MVAE-11
3	BOLTS & WOOD POLE WASHERS	2	M12x250mm COMPLETE
4	LONGROD INSULATOR	6	CULLINAN, EP 10442, 1200 CREEPAGE
5	STAY INSULATOR	2	CULLINAN, Z1-0522
6	THIMBLE CLEVIS	6	PIP, MTC 70
7	DEAD END	6	PIP, ADE 280
8	PG CLAMP	6	SEE DWG NO. STD-MVAE-08
9	MV STAY ASSEMBLY	2	11m 3/4.00mm STAY WIRE
10	POLE EARTH CONDUCTOR	40	3x32mm HOT DIP GALVANISED
11	STAPLES	1	20x9,7mm STAINLESS STEEL
12	BRAND-IT STRAPPING	1	
13	POLE CAP	1	
14	DANGER PLATE	1	

NOTES:

1. THE A-FRAME AND BOLTS C/W NUTS AND WASHERS SHALL BE HOT DIPPED GALVANISED TO SABS 763.
2. ALUMINIUM OXIDE GREASE SHALL BE USED ON ALL CLAMPS FOR CORROSION PROTECTION.
3. THE A-FRAME MUST BE EARTHED.

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA

Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE

**MEDIUM VOLTAGE BARE OVERHEAD DISTRIBUTION
 ANGLE POLE STRUCTURE, A-FRAME**

DESIGNED: AJK	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-MVAE-33KV-07	SCALE: N.T.S	

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127142043+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127142043+02'00')
/CreationDate
(johnny)
/Author
-mark-